
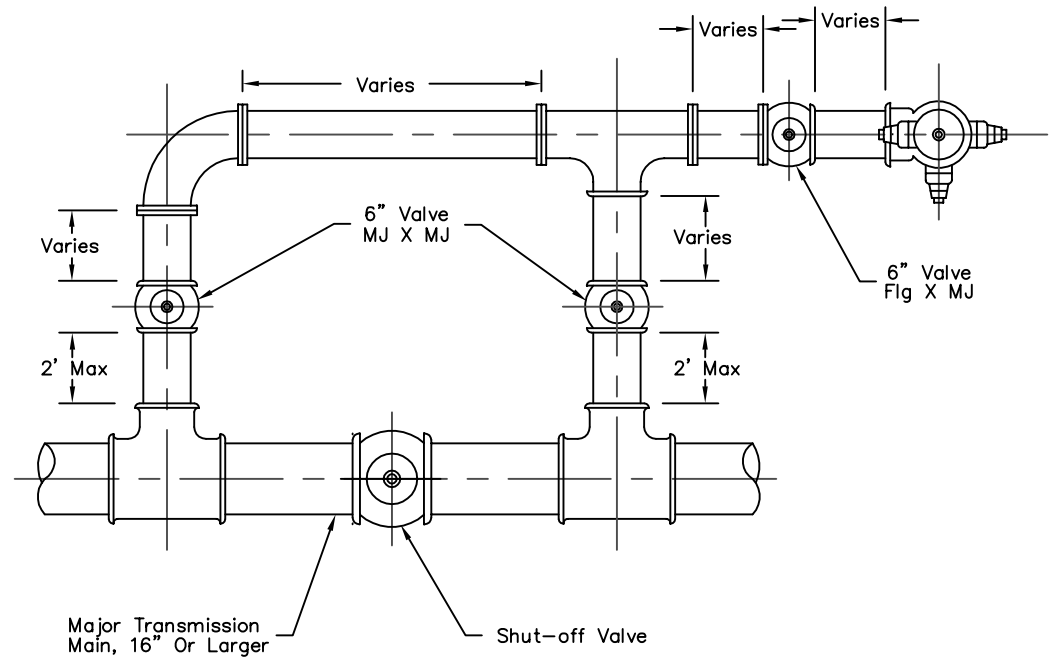


## NOTES

1. All joints in hydrant run-out to be restrained joints.
2. See MAG Std. Detail 391-C for valve box installation.
3. For water valve blocking see MAG Std. Detail 301.
4. For additional information see MAG Std. Detail 360.

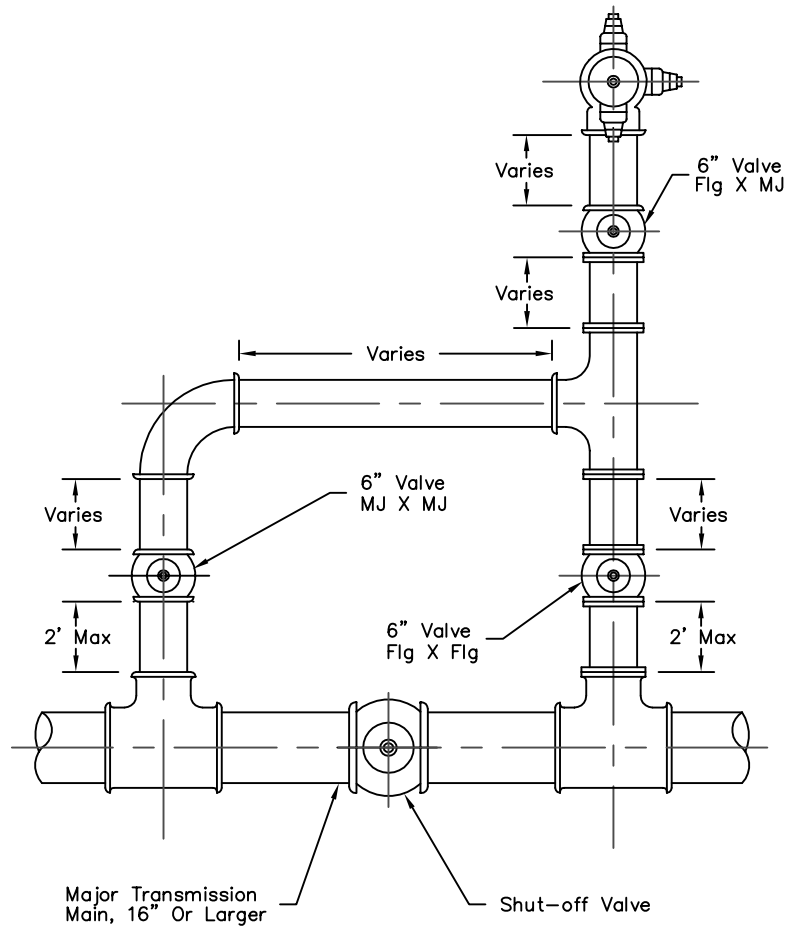

DETAIL NO. **2361** **City of Scottsdale**  
**Standard Details**

APPROVED BY: \_\_\_\_\_

**FIRE HYDRANT BYPASS ASSEMBLY**

DETAIL NO. **2361**